# ATS8W/ATS11W Series

## Twin Timer with Free Power, Compact Size W38×H42mm Features

- Wide power supply range
  - : 100-240VAC 50/60Hz, 24-240VDC universal. 24VAC 50/60Hz, 24VDC universal, 12VDC
- Various output operations (6 operation modes)
- Multi time range (12 types of time range)
- Twin timer to set ON/OFF time individually
- Close and DIN rail mounting with the dedicated socket (PS-M8) width 41mm (for ATS8W)
- · Easy installation/maintenance with the dedicated bracket for DIN 48×48mm
- Please read "Safety Considerations" in the instruction manual before using

# Ordering Information

ATS 8 W - 4 1



SENSORS CONTROLLERS

MOTION DEVICES

SOFTWARE

(J) Temperature Controllers

(K) SSRs

(L)

Power Controllers

(M) Counters

(N) Timers

Time range 1 Time range 1 (0.1 to 1) Time range 3 (0.3 to 3) 3 1 12VDC Power supply 2 24VAC 50/60Hz, 24VDC 100-240VAC 50/60Hz, 24-240VDC 4 Time operation W Twin (flicker) operation 8 Number of plug pins 8-pin plug type 11 11-pin plug type Item ATS Compact Analog Timer


\*\* 8-pin socket (PG-08, PS-08(N), PS-08) and 11-pin socket (PG-11, PS-11(N)) are sold separately.

### Specifications

lodel	ATS8W1 ATS11W1 ATS8W3 ATS11W3	(O) Digital				
unction	ON/OFF Flicker operation					
ontrol time setting ra	ge <sup>×1</sup> 0.1 sec to 10 hour 0.3 sec to 30 hour					
ower supply	•100-240VAC~ 50/60Hz, 24-240VDC= universal •24VAC~ 50/60Hz, 24VDC= universal •12VDC=					
llowable voltage rai	90 to 110% of rated voltage					
ower consumptior	•Max. 4.2VA (100-240VAC~), Max. 2W (24-240VDC==) •Max. 4.5VA (24VAC~), Max. 2W (24VDC==) •Max. 1.5W (12VDC==)					
eturn time	Max. 100ms					
iming operation	Power ON Start					
ontrol Contact	Time limit DPDT (2c) or Instantaneous SPDT (1c)+Time limit SPDT (1c) selectable by output operation mode					
utput Contact ca	pacity 250VAC~ 3A, 30VDC 3A resistive load	Display Unit				
elay life Mechani	Min. 10,000,000 operations					
ycle Electrica	Min. 100,000 operations (250VAC 3A resistive load)	Sensor Controllers				
epeat error	Max. ±0.2% ±10ms					
ET error	Max. ±5% ±50ms					
oltage error	Max. ±0.5%					
emperature error	Max. ±2%					
sulation resistanc	Over 100MΩ (at 500VDC megger)					
ielectric strength	2,000VAC 50/60Hz for 1 min					
loise ATS W ATS W	±500V the square wave noise (pulse width 1μs) by noise simulator					
<sup>nmunity</sup> ATS⊡W	$\pm 2kV$ the square wave noise (pulse width $1\mu$ s) by noise simulator					
ibration Mechani	0.75mm amplitude at frequency of 10 to 55Hz (for 1min) in each X, Y, Z direction for 1 hour					
Malfunct	0.5mm amplitude at frequency of 10 to 55Hz (for 1min) in each X, Y, Z direction for 10 min					
hock Mechani		Panel PC				
Malfunct						
nviron- Ambient t		Field Netw				
nent Ambient h	, , , , , , , , , , , , , , , , , , , ,	Devices				
pproval						
ccessory	Bracket					
/eight <sup>%2</sup>	Approx. 100g (approx. 75g)					
1: Refer to time sp	crifications for control time setting range by model.					




## Connections




%1: When selecting [F2], [N2] output operation mode.


%2: When selecting [F1], [F3], [N1], [N3] output operation mode.


#### Dimensions





#### O Bracket





### Unit Description


ON time/cycle range display part ON time/cycle range setting switch

Output operation mode display part (F1, F2, F3, N1, N2, N3 mode)

Output operation mode setting switch

OFF time range display part

OFF time range setting switch



ON operation indicator (red)

ON time/cycle setting dial


OFF operation indicator (green)

OFF time/ON duty (%) setting dial

# Time Specifications


Model	Time range	Time unit	Time setting range	Model	Time range	Time unit	Time setting range
ATS W-1	1S	SEC	0.1 to 1 sec	ATS W- 3	1S	SEC	0.3 to 3 sec
	10S		1 to 10 sec		10S		3 to 30 sec
	1M	MIN	0.1 to 1 min		1M	MIN	0.3 to 3 min
	10M		1 to 10 min		10M		3 to 30 min
	1H	HOUR	0.1 to 1 hour		1H	HOUR	0.3 to 3 hour
	10H		1 to 10 hour		10H		3 to 30 hour

#### **○ATS11W**




(unit: mm)

#### **O Panel cut-out**



## Output Operation Mode


[T<sub>oN</sub>: ON Setting time, T<sub>OFF</sub>: OFF Setting time, TIME: Cycle, DUTY: ON Time duty rate, Rt: Return time, Rt1>Rt ]

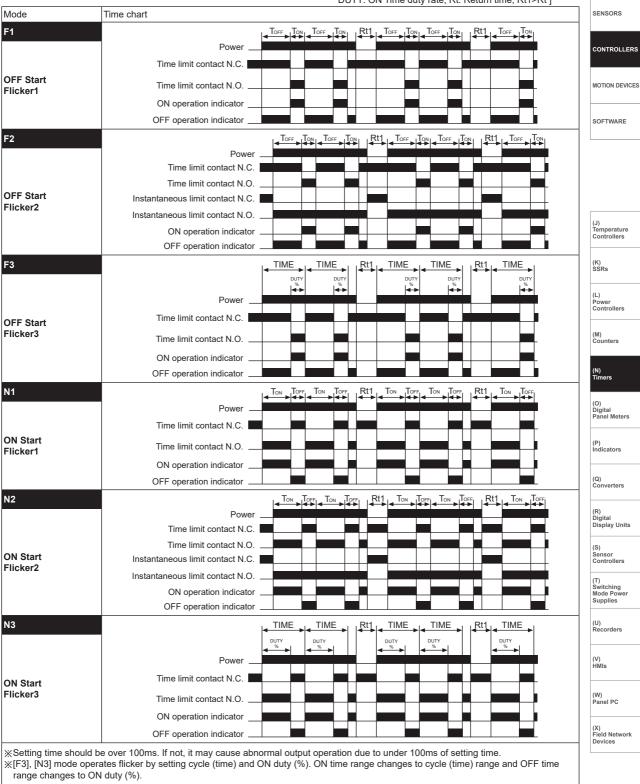


Autonics

## Proper Usage

- Follow instructions in 'Proper Usage'. Otherwise, it may cause unexpected accidents.
- 12VDC, 24VDC, 24VAC power supply should be insulated and limited voltage/current or Class 2, SELV power supply device.
- When supplying or turning off the power, use a switch or etc. to avoid chattering.
- Install a power switch or circuit breaker in the easily accessible place for supplying or disconnecting the power.
- In order to block peripheral current, use isolation transformer which of secondary part is not grounded as (Figure 1) to supply power to the external input device.

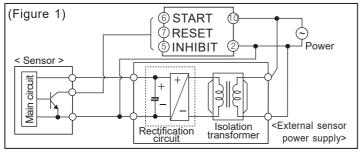

• In order to avoid leakage current flowing, connect resistance and condenser as (Figure 2). If connect as (Figure 1), it may cause malfunction due to leakage current.



- Do not connect two or more timers with only one input contact or transistor simultaneously.
- Keep away from high voltage lines or power lines to prevent inductive noise. In case installing power line and input signal line closely, use line filter or varistor at power line and shielded wire at input signal line.
- Do not use near the equipment which generates strong magnetic force or high frequency noise.
- Change setting time, time range, operation mode or etc. after turning off the power of the timer.
- This unit may be used in the following environments.
  ①Indoors (in the environment condition rated in 'Specifications')
  ②Altitude max. 2,000m
  ③Pollution degree 2
- Installation category II